

The apparatus may be held in place by it's effective air-weight or secured to prevent slippage during operation. Additionally, one or more warm air discharges may be added to control air flow. Optionally, more than one source and subsequent air ducts may be added to accommodate the environment.

Figures

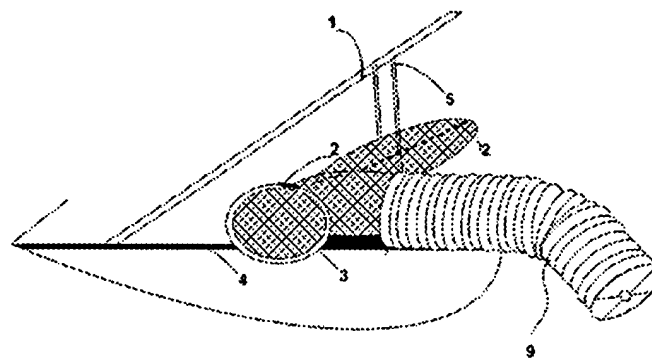


FIG. 1

1/4

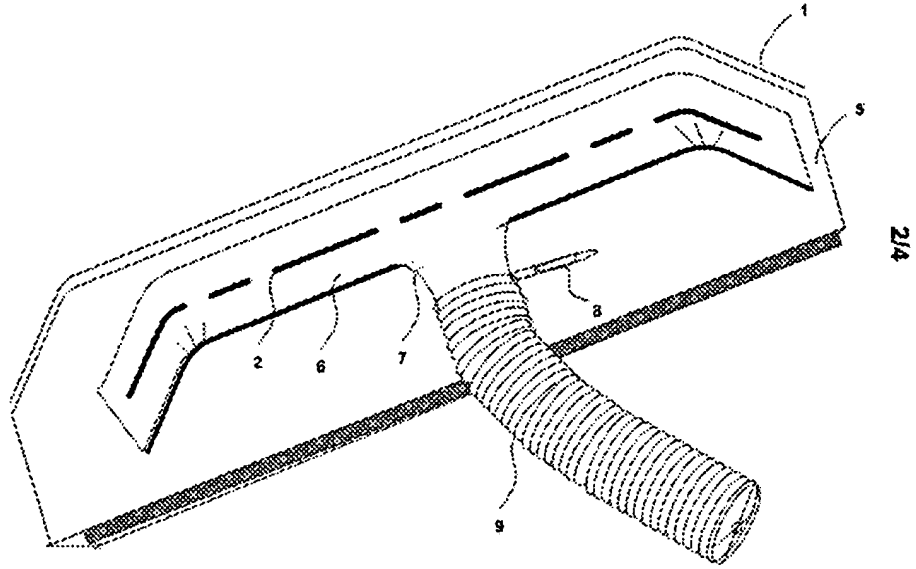


FIG. 2

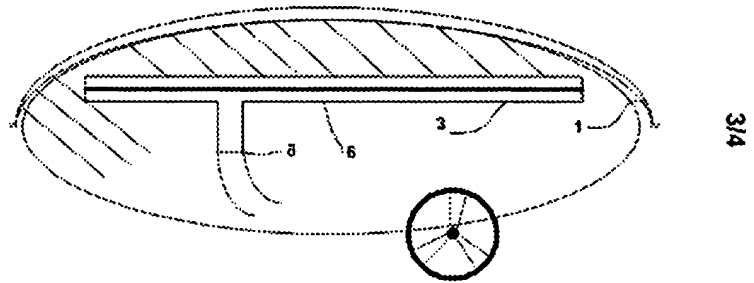


FIG. 3

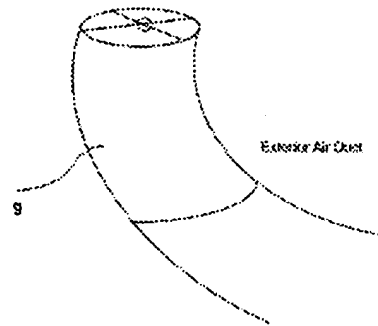
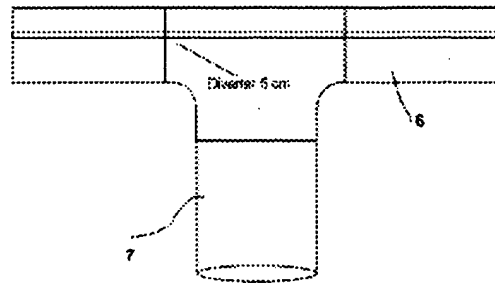


FIG. 4